


OSHA FALL PROTECTION TIPS

"Steep Roofs"

1926.501(b)(11)


Each employee on a steep roof with unprotected sides and edges *six feet or more above lower levels* shall be protected.

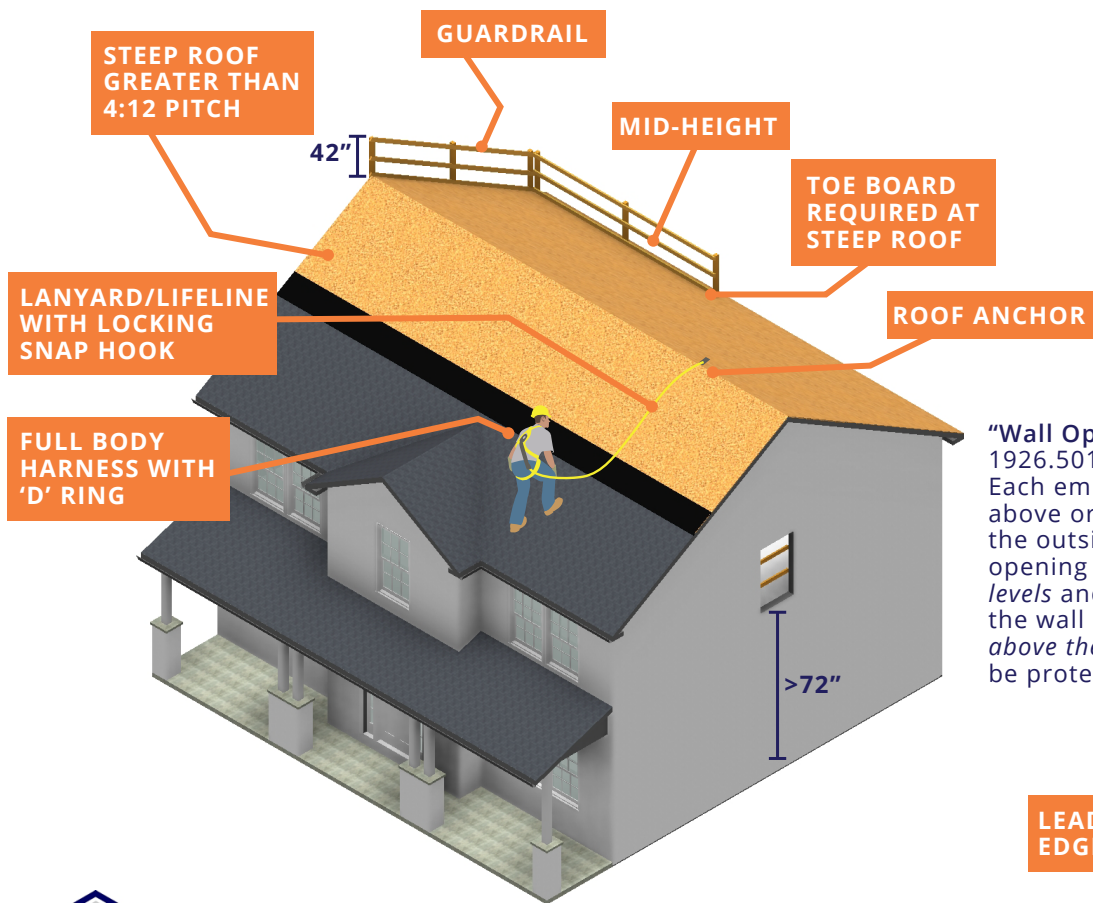

"Guardrail System"

1926.502(b)

- Top edge of rail 42" +/- 3"
- Mid Rail shall be installed at halfway point
- Surfaced to prevent injury
- Toe board required at steep roof

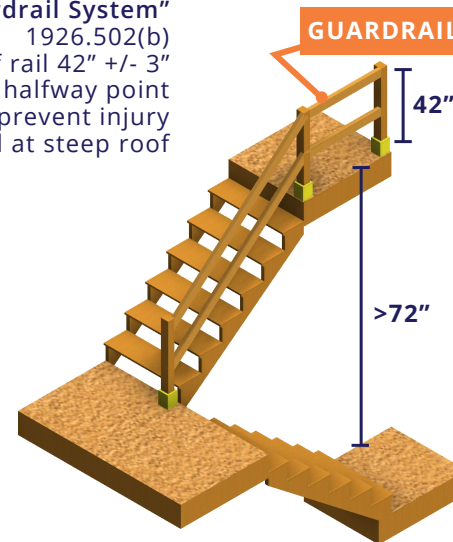

"Holes"

1926.501(b)(4)

Each employee on a walking/working surface shall be protected from fall through holes (including skylights) *more than 6 feet above lower levels*. (For example: roof skylights & stair openings)

"Wall Openings"


1926.501(b)(14)

Each employee working on, at, above or near wall openings where the outside bottom edge of the wall opening is *6 feet or more above lower levels* and the inside bottom edge of the wall opening is less than *39 inches above the walking/working surface* shall be protected.

"Leading Edges"

1926.501(b)(2)

Each employee who is constructing a leading edge *6 feet or more above a lower level* shall be protected.

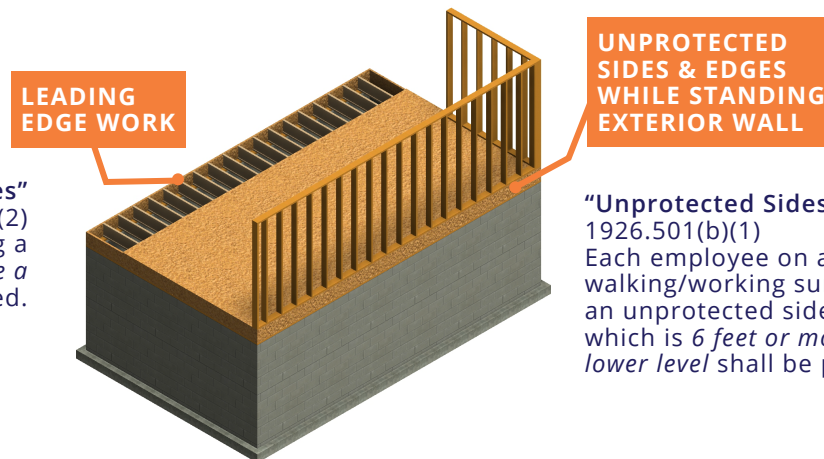

"Unprotected Sides and Edges"

1926.501(b)(1)

Each employee on a walking/working surface with an unprotected side or edge which is *6 feet or more above a lower level* shall be protected.



PENNSYLVANIA HOUSING RESEARCH CENTER

Penn State University | 219 Sackett Building University Park, PA 16802
Telephone: (814) 865 2341 | Fax: (814) 863 7304 | www.engr.psu.edu/phrc

FEBRUARY 2014

*For full OSHA fall protection regulations, please see www.OSHA.gov.